

# Exo Dual Flush Mount

700FMEXOD\_ 1.1



FLUSH

**GENERAL PRODUCT INFORMATION:**

These fixtures are intended to be installed utilizing NEC compliant junction boxes.




This product is suitable for damp locations.

This product can be dimmed with a low-voltage electronic dimmer, 0-10V dimmer or TRIAC dimmer.




**CAUTION - RISK OF FIRE**  
 This product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.  
**Use minimum 90°C supply conductors.**


**SAVE THESE INSTRUCTIONS!**

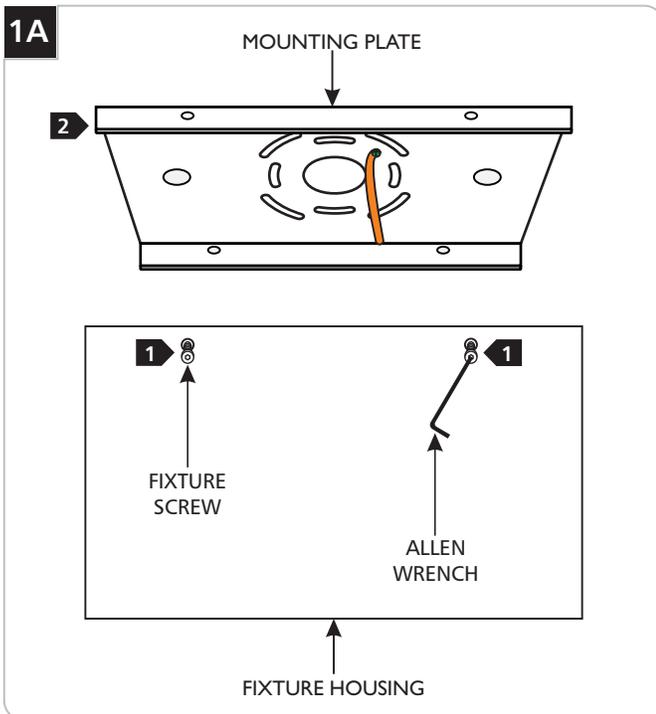


- 1** Remove the fixture screws located on both sides of the fixture housing using the provided Allen wrench.
- 2** Remove the mounting plate from the fixture base.

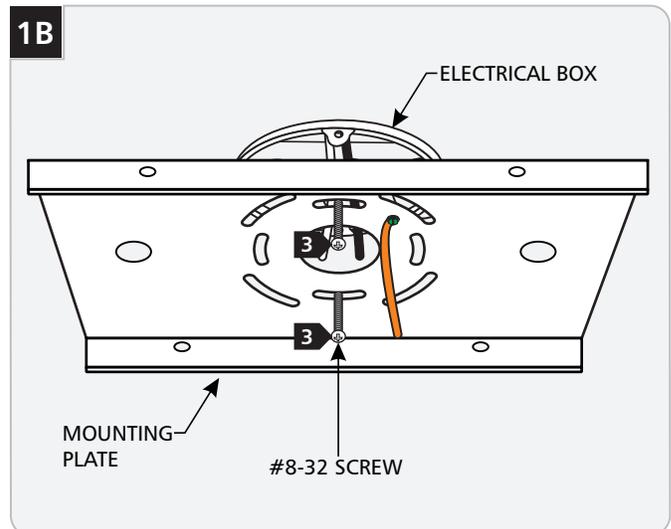

- 3** Secure the mounting plate to the electrical box with the two #8-32 screws provided.

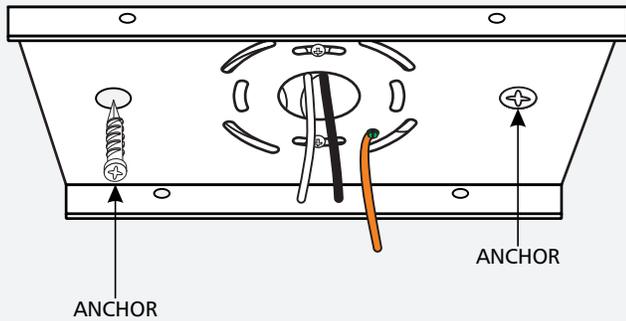
**1C**

- 4** Line up an anchor with the center of a backplate hole and push the anchor in up to the threads.
- 5** Screw the anchor the rest of the way in with a screwdriver.

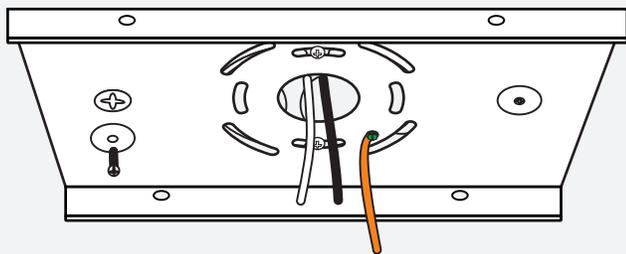**1D**

- 6** Secure the backplate to the anchor with a screw and washer.
- 7** Repeat steps 4-6 for the remaining anchor hole.


## Install the Fixture

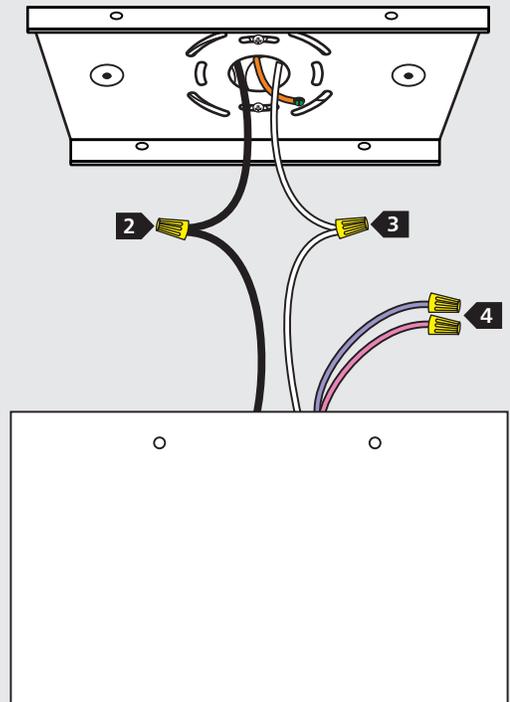**2A**

- 1** Connect the fixture to a suitable ground in accordance with local electrical codes.
- 2** Connect the black driver wires to the hot power line wire with a wire nut.
- 3** Connect the white driver wires to the neutral power line wire with a wire nut.
- 4** For 0-10V dimming, use the purple and gray/pink wires to connect to a compatible dimmer. Keep wires capped if not in use.
- 5** Place all wires and wire nut connections inside the fixture base.
- 6** Reinstall the fixture housing to the mounting plate using the fixture screws (reversal of step 1A).

## Adjust the Module

3A

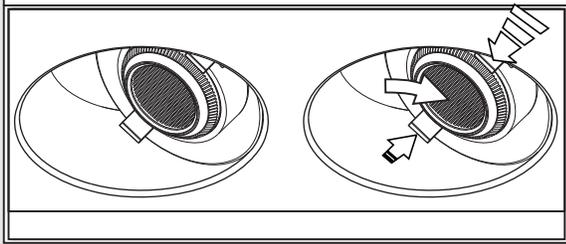


**WARNING:** Always squeeze the two tabs when adjusting the LED housing. Failure to do so will damage the finish.

- 1 Squeeze the LED housing tabs and rotate the LED housing to the desired position.

## Optics and Lenses

4A

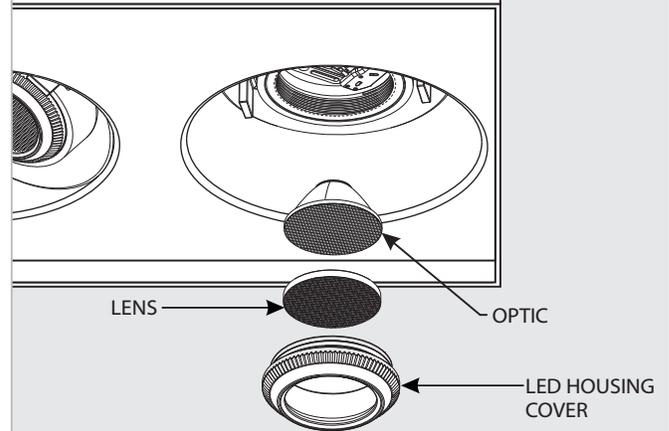

- 1 Unscrew and remove the LED housing cover.
- 2 Remove the optic.
- 3 If installing an optional lens, rest the lens inside the housing cover.
- 4 Install the optic (replacement or existing) inside the LED housing cover.
- 5 Screw the LED housing cover back on.



7400 Linder Ave., Skokie, IL 60077

T 847.410.4400 | F 847.410.4500

[www.techlighting.com](http://www.techlighting.com)